


TYPE R-3

- 1. 8.33% (12:1) MAX RAMP SLOPE
- 2. CROSS SLOPE: 2.00%
- 3. CURB RAMPS REQUIRE A (4'-0") MINIMUM LANDING WITH A MAXIMUM CROSS SLOPE AND LONGITUDINAL SLOPE OF 2.00% WHERE PEDESTRIANS PERFORM TURNING MANEUVERS. SLOPE TO DRAIN TO CURB.
- 4. RAMPS AND DOMES SHALL BE INSTALLED THE SAME WIDTH AS THE SIDEWALK.



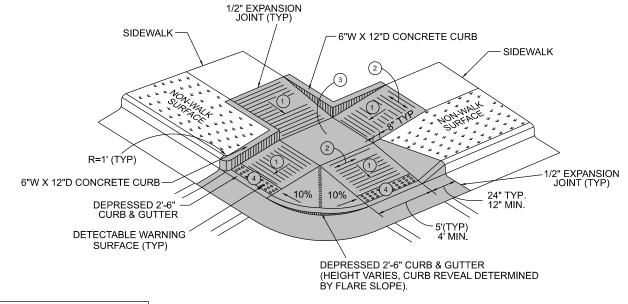

## TYPE R-4



## CURB RAMPS - RETROFIT

DESIGNED BY:	REVISED
TOG	FEB. 2022
APPROVED BY:	STD. NO.

T-2.01.6

CSJ

TOWN	OF	GARNER,	N.C.
------	----	---------	------