



CROSS SECTION

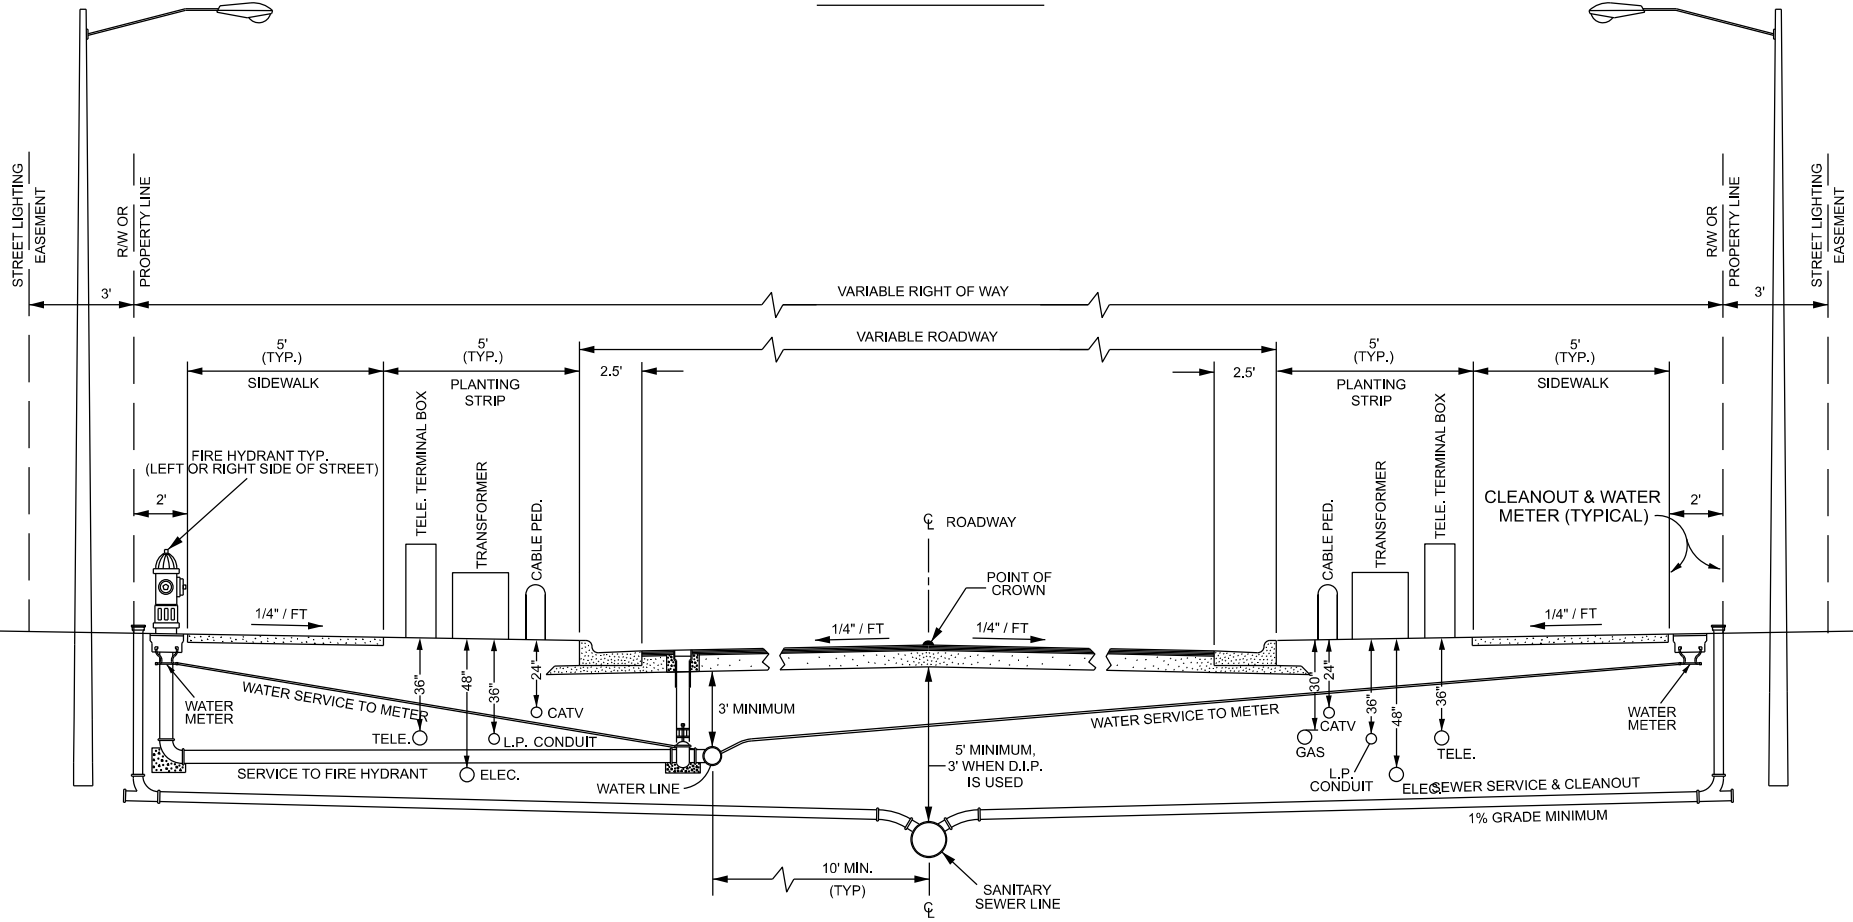

NOTES:

1. WATER AND/OR SANITARY SEWER LINES SHALL BE A MINIMUM OF TWO FEET FROM THE EDGE OF THE CURB AND GUTTER.
2. ENCROACHMENT ONTO TOWN MAINTAINED RIGHT OF WAY SHALL FOLLOW CONDITIONS OF THE APPLICABLE ENCROACHMENT AGREEMENT OR FRANCHISE AGREEMENT.
3. FOR HYDRANT LOCATION SEE PUBLIC UTILITIES STANDARD DETAIL W-4.



STANDARD UTILITY LOCATIONS IN STREET

TOWN OF GARNER, N.C.

DESIGNED BY:
TOG

APPROVED BY:
CSJ

REVISED
FEB. 2022

STD. NO.
T-3.01