


FRONT VIEW

THE EDGES OF THE DRAIN HOLE OR BORE MUST BE ROUNDED AND FINISHED SMOOTH AT THE FACE OF THE CURB.

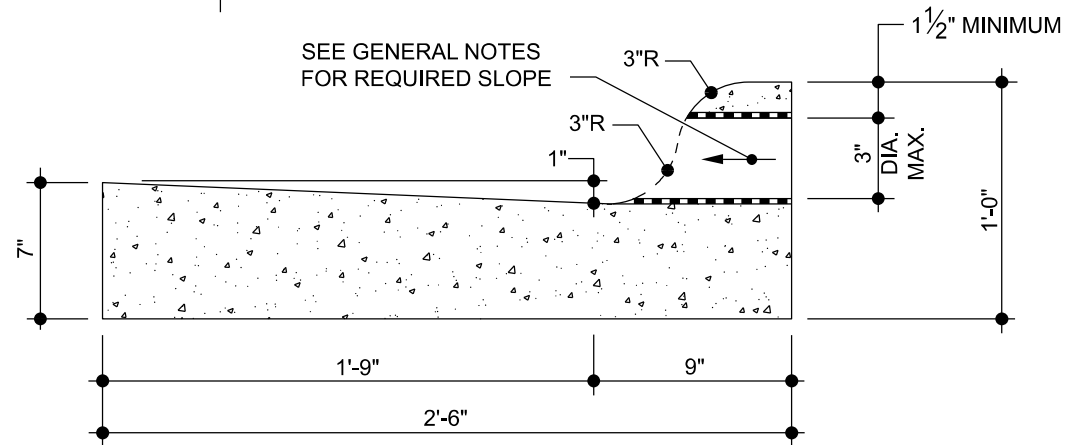

SECTION A-A

SEE GENERAL NOTES FOR REQUIRED SLOPE

GENERAL NOTES:

1. CURB DRAINS SHALL NOT BE CONSTRUCTED WITHIN 18 INCHES OF CONTRACTION OR EXPANSION JOINTS.
2. OPENING GRADE MAY VARY BETWEEN A MAXIMUM SLOPE OF 1/2" PER FT. AND A MINIMUM OF 1/4" PER FT.
3. MORE THAN ONE HOLE MAY BE INSTALLED PROVIDED THE HOLES ARE LOCATED WITH 18 INCHES MINIMUM SPACING.
4. IN LIEU OF CUTTING THE CURB TO INSTALL A 3 INCH PIPE, A 4 INCH CONCRETE BORE MAY BE USED.
 - A) BORE OR REMOVE & REPOUR 5 FOOT SECTION OF CURB, NO CUTTING OUT TOP OF CURB.
 - B) MAY NEED PERMIT AND/OR ENCROACHMENT AGREEMENT FROM THE PUBLIC WORKS AND/OR TRANSPORTATION & FACILITIES DEPARTMENTS.



STANDARD CURB DRAIN

TOWN OF GARNER, N.C.

DESIGNED BY:

TOG

APPROVED BY:

CSJ

REVISED
FEB. 2022

STD. NO.
T-4.06